


Supplemental Data

Durable SARS-CoV-2 B cell immunity after mild or severe disease

Clinton O. Ogega¹, Nicole E. Skinner¹, Paul W. Blair¹, Han-Sol Park², Kirsten Littlefield², Abhinaya Ganesan², Pranay Ladiwala³, Annukka AR Antar¹, Stuart C. Ray¹, Michael J. Betenbaugh³, Andrew Pekosz², Sabra L. Klein², Yukari C. Manabe¹, Andrea L. Cox^{1,2}, and Justin R. Bailey^{1*}

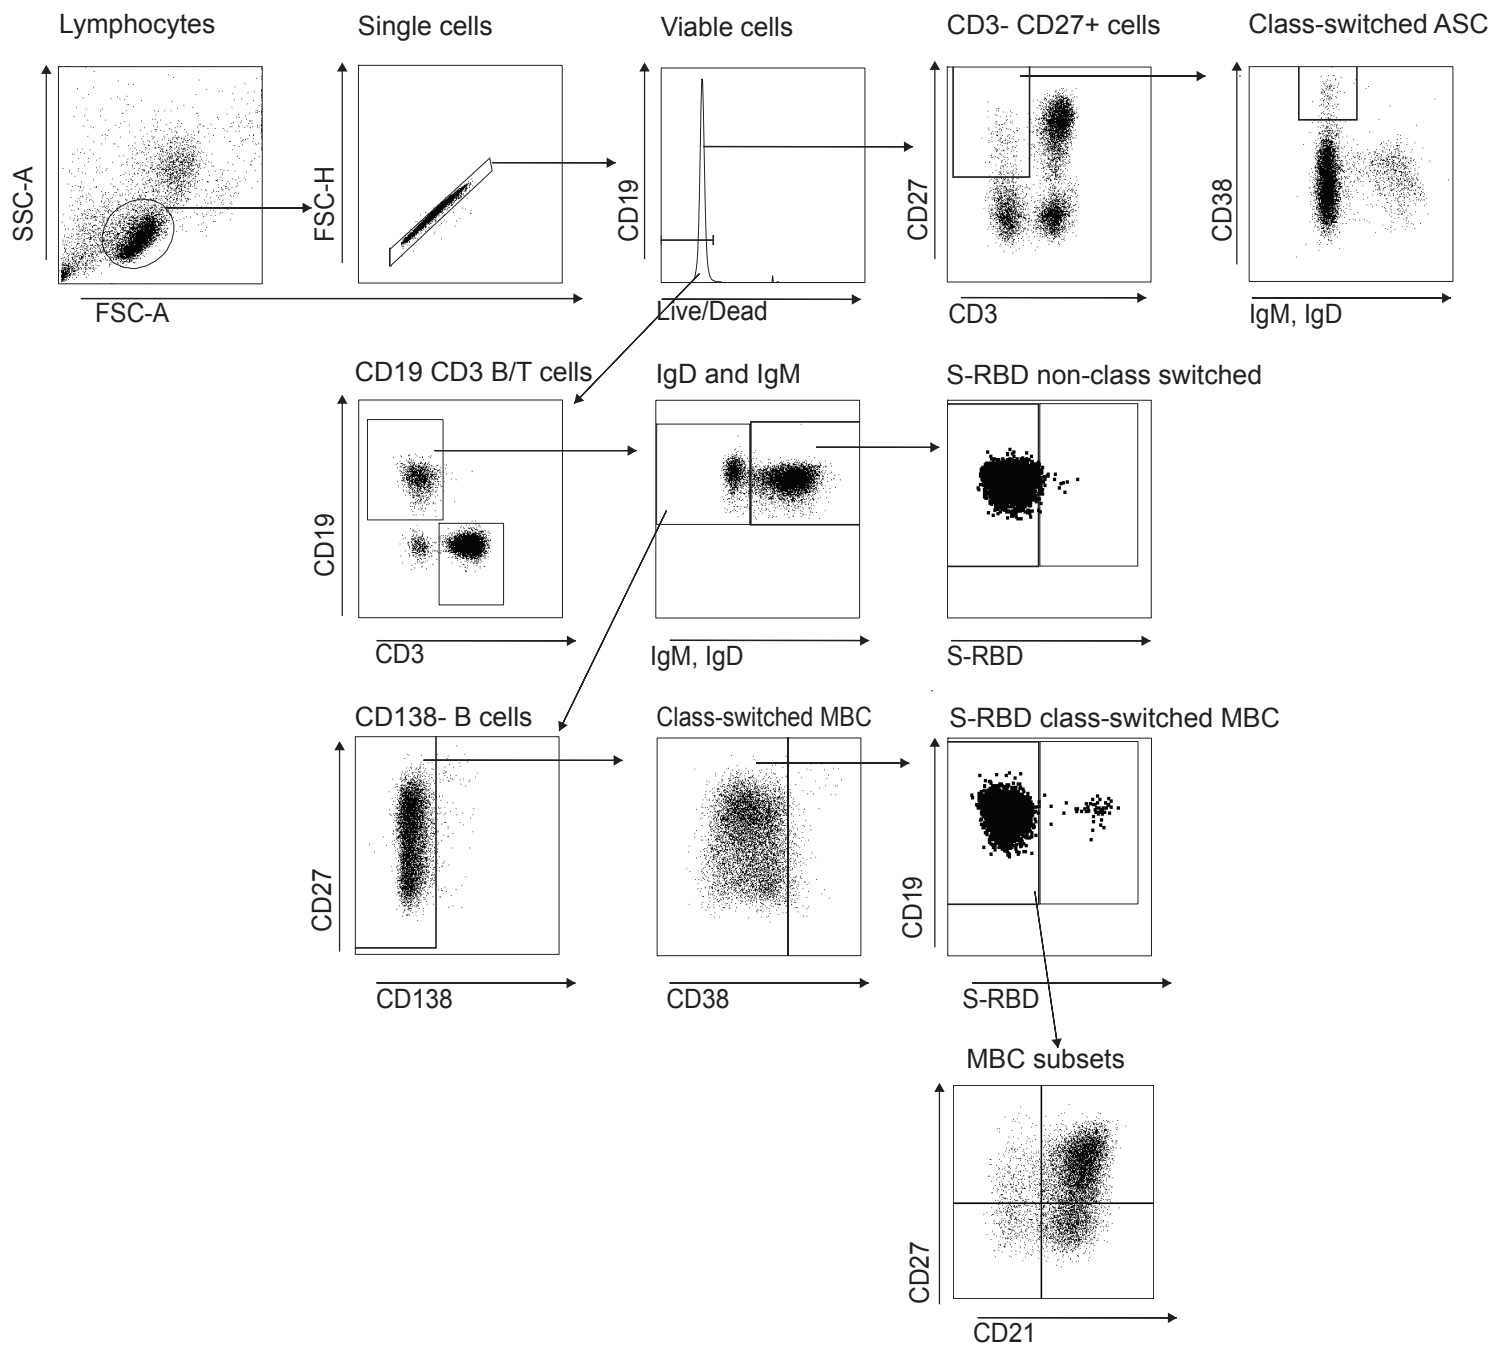

Supplemental Figure 1: Gating schematic. All antibodies used are listed in supplemental table 1. Fluorescence minus one (FMO) and isotype controls were used as guide to differentiate positive and negative populations. For S-RBD specific B cells, healthy participants were used as controls to set the gate for positive cells. All cells were run on an LSRII flow cytometer and analyzed using FlowJo.

Supplemental Table 1. Antibodies used

Marker	Fluorophore	Clone	Cat #	Vendor
IgM	BB515	G20-127	564622	BD Biosciences
IgD	BB515	IA6-2	565243	BD Biosciences
CD19	APC-R700	HIB19	564977	BD Biosciences
CD3	APC-H7	SK7	560176	BD Biosciences
CD138	BV711	MI15	563184	BD Biosciences
CD21	PE-CF594	B-LY4	563474	BD Biosciences
CD27	BV786	L128	563327	BD Biosciences
CD38	BB700	HIT2	566445	BD Biosciences
BTLA (CD272)	BV421	J168-540	564802	BD Biosciences
CD22	PE-Cy7	HIB22	563941	BD Biosciences
FCRL5 (CD307e)	PE	509F6	566734	BD Biosciences
CXCR5 (CD185)	BV480	RF8B2	566142	BD Biosciences
6x-His Tag mAb	Alexa Fluor 647	HIS.H8	MA1-21315-A647	ThermoFisher
Fixable Yellow Dead	BV480	Viability Dye	L34968	ThermoFisher
IgG1 Kpa ItCl	BB700	X40	566404	BD Biosciences
IgG1 Kpa ItCl	BV711	X40	563044	BD Biosciences
IgG1 Kpa ItCl	BV421	X40	562438	BD Biosciences
IgG1 Kpa ItCl	PE-Cy7	MOPC-21	557872	BD Biosciences
IgG2a Kpa ItCl	PE	G155-178	554648	BD Biosciences
Rat/Ham Ig Kpa Comp Bead			552845	BD Biosciences
Ms Ig Kpa Comp Bead Set			552843	BD Biosciences
Hu Fc Block Pure Fc1.3216			564220	BD Biosciences
ArC Amine Comp			A10346	ThermoFisher